


Llanwonno Energy Project

Constraints Plan: Utilities and Infrastructure

Scale 1:7500
Date: 14/03/25
Drwg: L05-2h

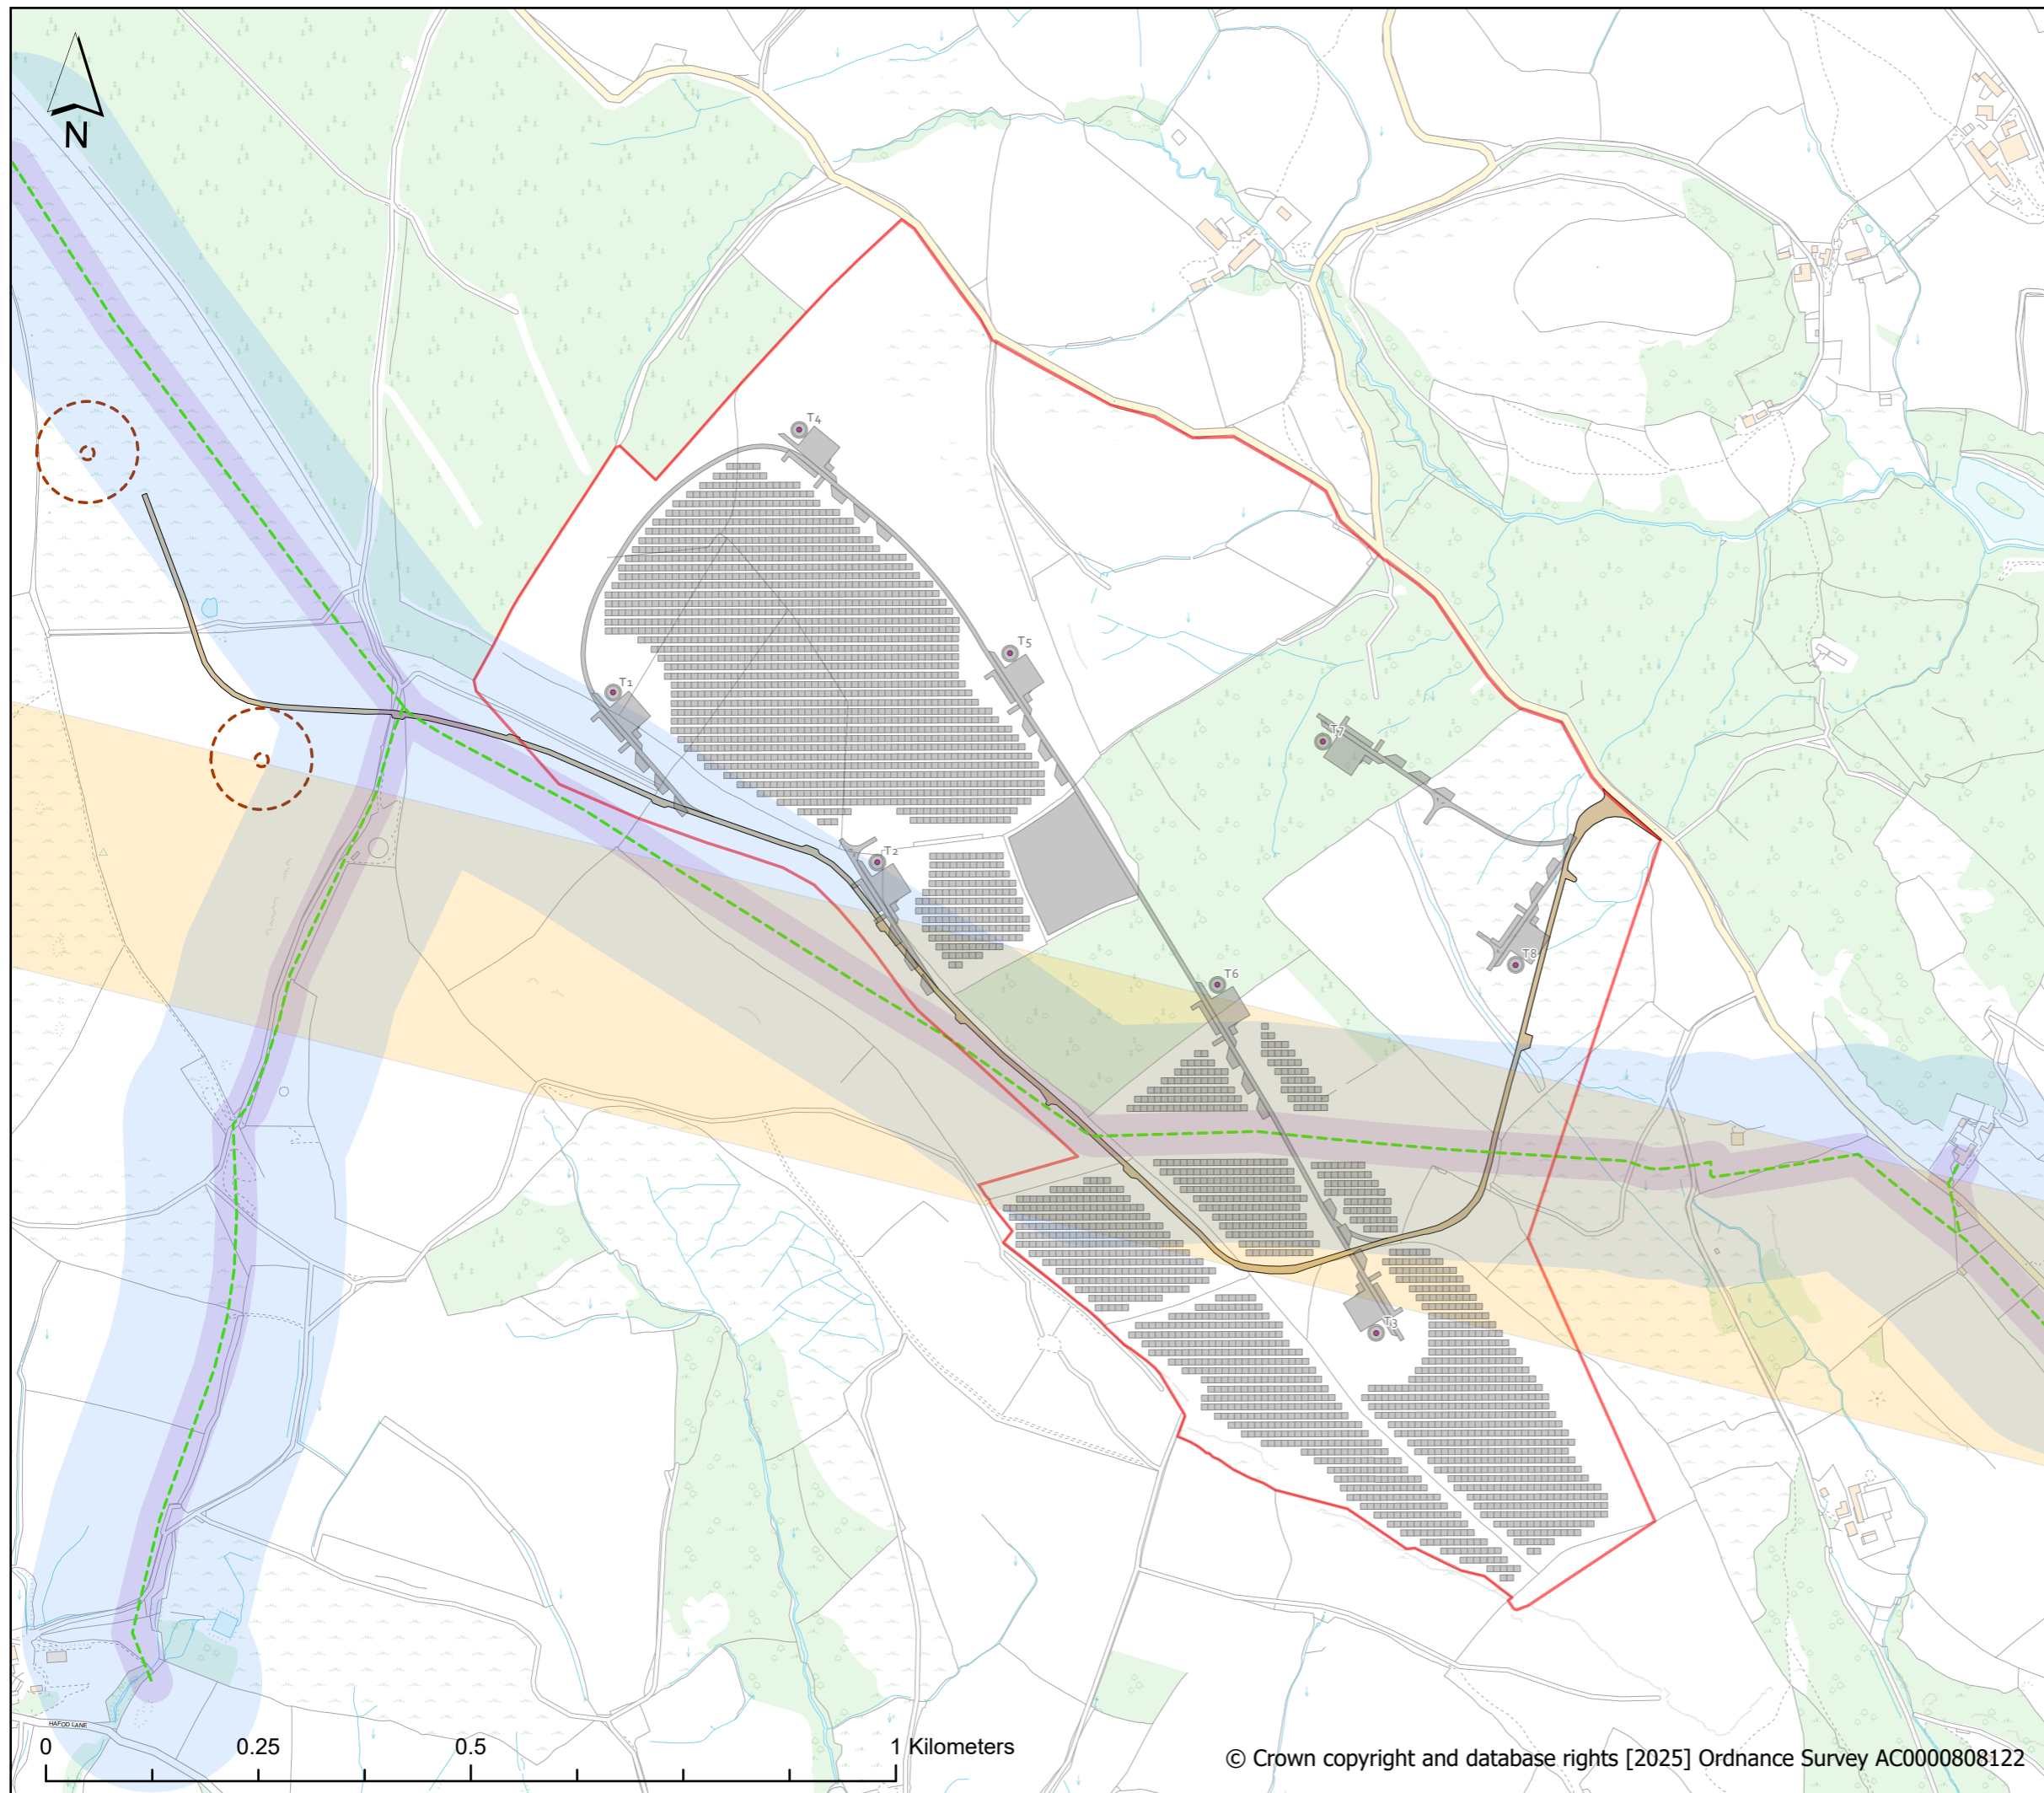

- Site boundary
- Proposed Llanwonno Energy site elements
- Turbine locations
- Existing track
- Telecoms operator's recommended 150m buffer from microwave link to turbine towers
- WWU High pressure gas pipeline
- 25m gas pipeline buffer to solar infrastructure
- UKOPA recommended high pressure gas buffer 1.5x hub height from gas line to turbine towers
- Existing turbines 15/1635/FUL

Drawing revisions

Client